
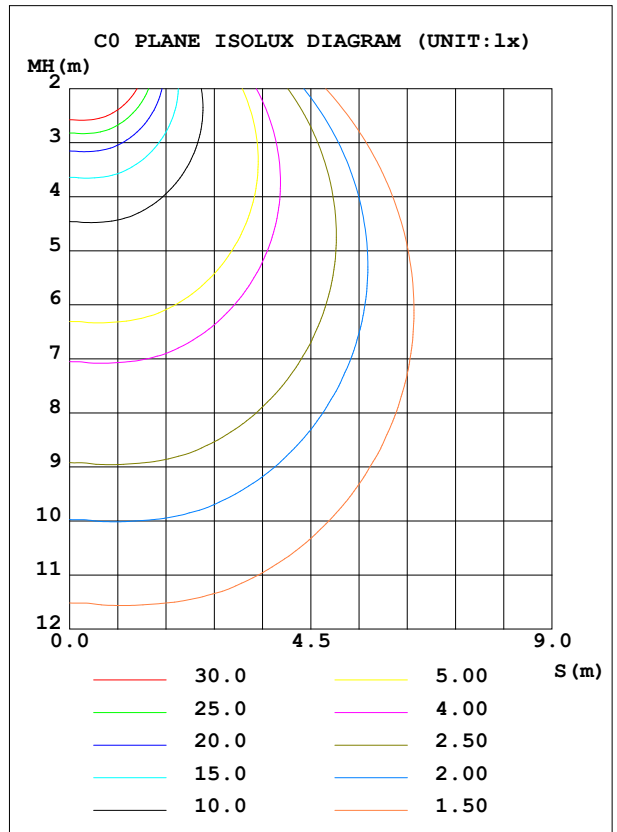


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.31V I:0.0637A P:13.615W PF:0.9707 Freq:50.00Hz Lamp Flux:952.92x1 lm		
NAME: GTG5081A-MCA125A-P03-12W-G4000K	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA			
MODEL		Imax (cd)	225.8	S/MH (C0/180)	1.51
NOMINAL POWER (W)	--	LOR (%)	100.0	S/MH (C90/270)	1.70
RATED VOLTAGE (V)	--	TOTAL FLUX (lm)	952.92	η UP, DN (C0-180)	2.6, 32.0
NOMINAL FLUX (lm)	952.92	CIE CLASS	SEMI-D.	η UP, DN (C180-360)	11.2, 54.2
LAMPS INSIDE	1	η up (%)	13.8	CIBSE SHR NOM	1.50
TEST VOLTAGE (V)	--	η down (%)	86.2	CIBSE SHR MAX	1.55

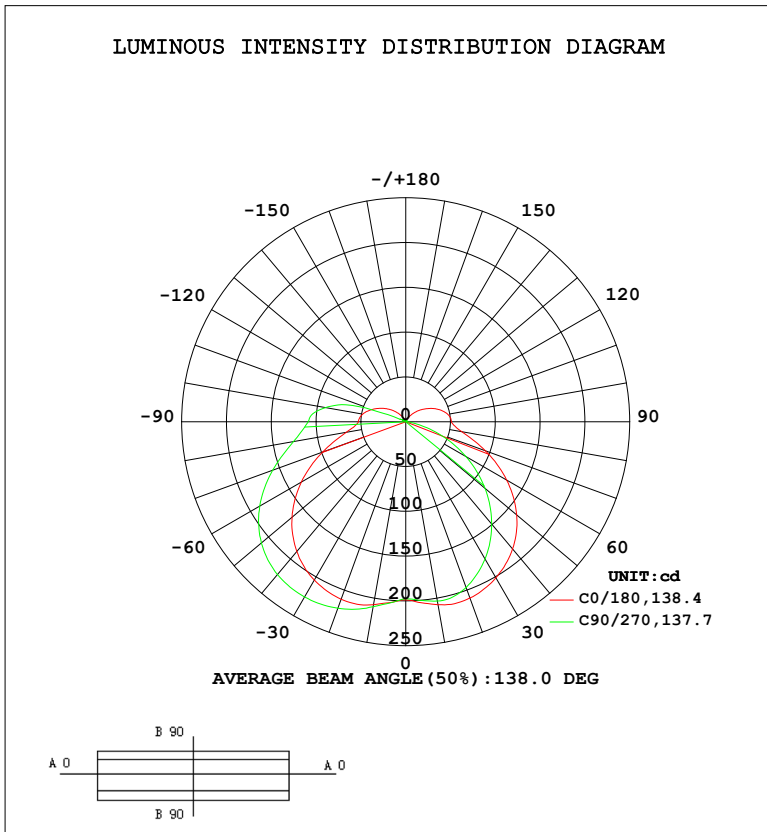

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators:
 Test Date: 2024-07-06

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	207.4	204.2	203.2	203.7	207.3	208.6	209.6	207.6	0- 10	19.39	19.39	2.03,2.03
20	209.3	198.7	197.0	198.5	210.9	219.6	221.6	217.8	10- 20	59.24	78.63	8.25,8.25
30	201.1	180.0	176.9	180.3	204.0	223.0	225.8	220.2	20- 30	95.20	173.8	18.2,18.2
40	185.5	153.4	149.2	153.0	189.2	218.7	222.6	215.1	30- 40	121.8	295.6	31,31
50	161.6	119.9	115.5	119.2	165.5	204.8	210.3	200.9	40- 50	135.0	430.7	45.2,45.2
60	130.1	81.66	77.41	80.88	134.5	181.4	188.2	177.4	50- 60	131.9	562.6	59,59
70	94.53	42.14	38.78	41.42	98.74	150.1	158.0	146.4	60- 70	112.9	675.4	70.9,70.9
80	63.38	10.42	8.701	10.14	67.26	118.7	127.2	115.1	70- 80	83.99	759.4	79.7,79.7
90	51.05	1.928	1.182	2.203	52.97	100.4	108.9	97.47	80- 90	62.32	821.8	86.2,86.2
100	47.79	1.976	1.432	2.185	48.97	73.98	91.08	73.84	90-100	53.24	875.0	91.8,91.8
110	39.76	2.116	1.807	2.199	40.20	37.18	32.61	36.69	100-110	37.41	912.4	95.7,95.7
120	29.71	2.240	2.018	2.224	30.19	13.33	3.298	11.68	110-120	19.90	932.3	97.8,97.8
130	20.11	2.276	2.142	2.209	20.34	6.153	1.349	4.160	120-130	10.27	942.6	98.9,98.9
140	11.26	2.234	2.198	2.155	11.33	7.356	1.292	6.091	130-140	5.569	948.2	99.5,99.5
150	4.471	2.166	2.221	2.068	4.351	4.769	1.497	4.563	140-150	2.898	951.0	99.8,99.8
160	2.012	2.118	2.178	2.062	1.943	1.866	1.681	2.011	150-160	1.126	952.2	99.9,99.9
170	2.018	2.079	2.084	2.063	1.989	1.869	1.867	1.904	160-170	0.5528	952.7	100,100
180	2.090	2.022	2.015	2.033	2.096	2.022	2.017	2.031	170-180	0.1914	952.9	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 362.48 lm

%lum = 38.0%
 %lamp = 38.0%


Conical surface Flux(120deg): 562.58 lm

%lum = 59.0%
 %lamp = 59.0%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:
 Test Date:2024-07-06

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

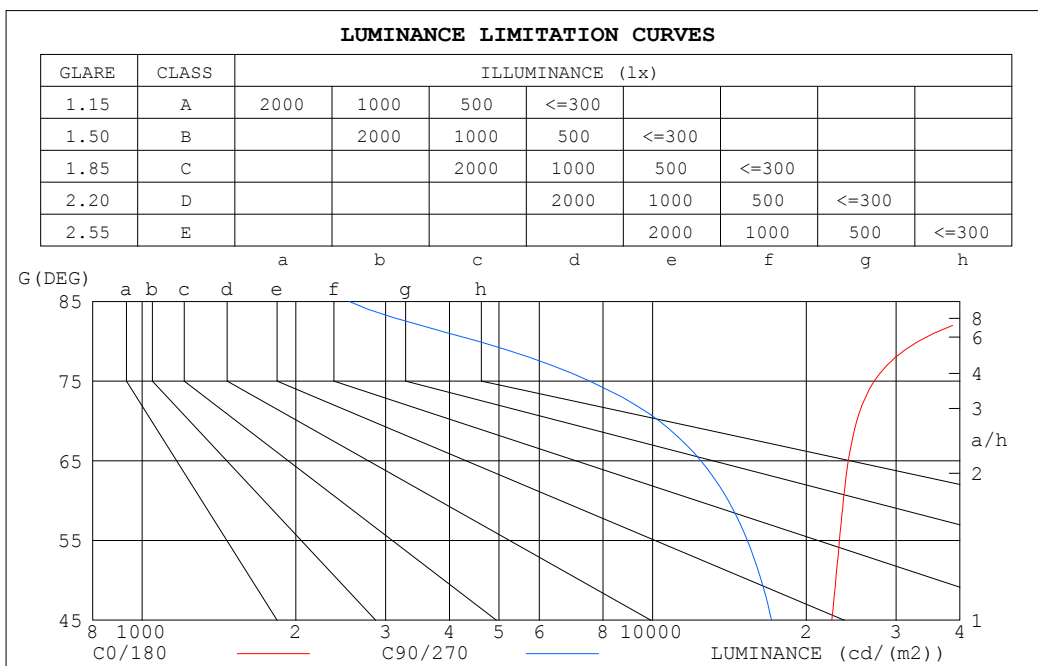


LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	57215	2548
80	33183	4555
75	27175	7530
70	25125	10308
65	24181	12430
60	23647	14074
55	23226	15333
50	22856	16336
45	22445	17105

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators:
 Test Date: 2024-07-06

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.16	1.16	1.16	1.11	1.11	1.11	1.03	1.03	1.03	.96	.96	.96	.89	.89	.89	.86
1.0	.97	.92	.87	.94	.89	.85	.87	.83	.79	.80	.77	.75	.75	.72	.70	.67
2.0	.83	.76	.69	.80	.73	.67	.74	.69	.64	.69	.64	.60	.64	.60	.57	.54
3.0	.72	.63	.56	.70	.62	.55	.65	.58	.52	.60	.54	.50	.56	.51	.47	.44
4.0	.64	.54	.47	.61	.53	.46	.57	.50	.44	.53	.47	.42	.49	.44	.40	.37
5.0	.56	.47	.40	.54	.46	.39	.51	.43	.37	.47	.41	.36	.44	.38	.34	.31
6.0	.50	.41	.34	.49	.40	.34	.45	.38	.32	.42	.36	.31	.40	.34	.29	.27
7.0	.45	.36	.30	.44	.35	.29	.41	.34	.28	.38	.32	.27	.36	.30	.26	.24
8.0	.41	.32	.26	.40	.32	.26	.37	.30	.25	.35	.29	.24	.33	.27	.23	.21
9.0	.38	.29	.24	.37	.29	.23	.34	.27	.22	.32	.26	.21	.30	.25	.21	.19
10.0	.35	.27	.21	.34	.26	.21	.32	.25	.20	.30	.24	.19	.28	.23	.19	.17

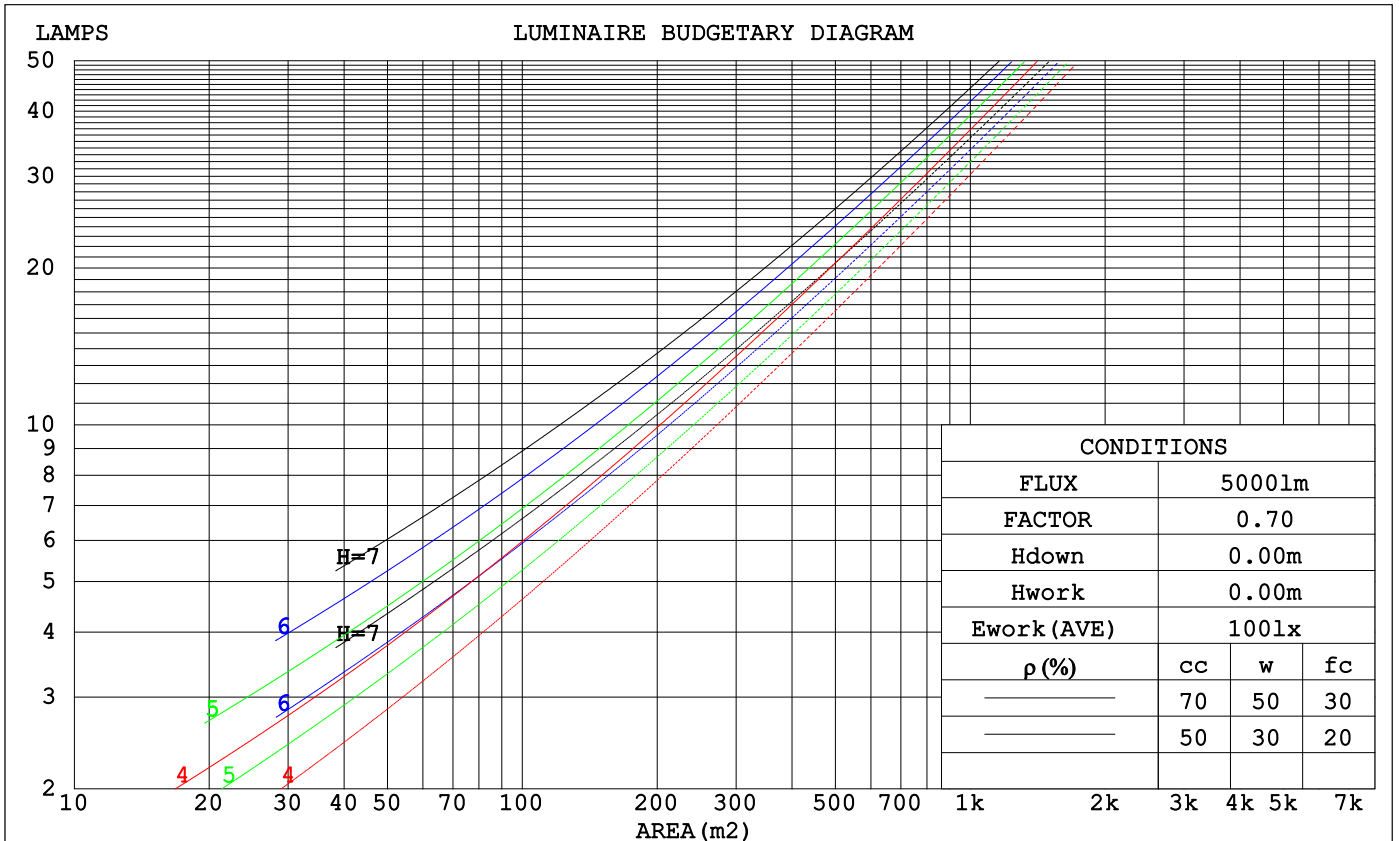

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:
 Test Date:2024-07-06

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks:

WEC AND CCEC

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.373	.212	.067	.362	.206	.066	.340	.195	.062	.321	.185	.059	.303	.175	.057	
2.0	.328	.180	.055	.317	.175	.054	.298	.166	.051	.280	.157	.049	.264	.149	.047	
3.0	.293	.156	.047	.284	.152	.046	.267	.145	.044	.251	.137	.042	.236	.131	.040	
4.0	.265	.138	.041	.257	.135	.040	.241	.128	.038	.227	.122	.037	.213	.116	.035	
5.0	.242	.123	.036	.235	.120	.035	.220	.115	.034	.207	.109	.032	.195	.104	.031	
6.0	.222	.111	.032	.215	.109	.031	.203	.104	.030	.190	.099	.029	.179	.094	.028	
7.0	.205	.102	.029	.199	.099	.028	.187	.095	.027	.176	.090	.026	.166	.086	.025	
8.0	.191	.093	.026	.185	.091	.026	.174	.087	.025	.164	.083	.024	.155	.079	.023	
9.0	.178	.086	.024	.173	.084	.024	.163	.080	.023	.153	.077	.022	.145	.073	.021	
10.0	.167	.080	.022	.162	.078	.022	.153	.075	.021	.144	.072	.020	.136	.068	.020	

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.295	.295	.295	.252	.252	.252	.172	.172	.172	.099	.099	.099	.032	.032	.032	
1.0	.290	.261	.235	.249	.224	.202	.170	.154	.140	.098	.089	.081	.031	.029	.026	
2.0	.283	.238	.200	.243	.205	.173	.166	.142	.121	.096	.083	.071	.031	.027	.023	
3.0	.276	.221	.178	.237	.191	.154	.162	.133	.108	.094	.078	.064	.030	.025	.021	
4.0	.268	.209	.163	.230	.180	.142	.158	.126	.100	.092	.074	.059	.029	.024	.019	
5.0	.261	.199	.153	.224	.172	.133	.154	.120	.094	.089	.071	.056	.029	.023	.018	
6.0	.253	.191	.146	.218	.165	.127	.150	.116	.090	.087	.068	.053	.028	.022	.018	
7.0	.246	.184	.141	.212	.160	.123	.146	.112	.087	.085	.066	.052	.027	.022	.017	
8.0	.240	.179	.137	.206	.155	.119	.143	.109	.085	.083	.064	.050	.027	.021	.017	
9.0	.233	.174	.134	.201	.151	.117	.139	.106	.083	.081	.063	.049	.026	.021	.016	
10.0	.228	.170	.131	.196	.147	.114	.136	.104	.081	.079	.061	.049	.026	.020	.016	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:
 Test Date:2024-07-06

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 γ Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	22.0	23.4	22.4	23.8	24.3	20.1	21.6	20.6	22.0	22.5
3H	23.9	25.2	24.4	25.7	26.2	21.1	22.4	21.6	22.9	23.4
4H	24.9	26.1	25.4	26.6	27.2	21.3	22.5	21.8	23.0	23.6
6H	25.9	27.1	26.4	27.6	28.2	21.3	22.5	21.8	23.0	23.6
8H	26.5	27.7	27.1	28.2	28.8	21.3	22.4	21.8	22.9	23.5
12H	27.3	28.4	27.8	28.9	29.5	21.2	22.3	21.8	22.8	23.4
4H 2H	22.1	23.4	22.7	23.9	24.4	20.6	21.9	21.1	22.4	22.9
3H	24.2	25.3	24.7	25.8	26.4	21.7	22.8	22.2	23.3	23.9
4H	25.3	26.3	25.8	26.8	27.4	22.0	23.0	22.5	23.5	24.1
6H	26.4	27.3	27.0	27.9	28.6	22.0	22.9	22.6	23.5	24.2
8H	27.2	28.0	27.8	28.6	29.3	22.0	22.8	22.6	23.4	24.1
12H	28.1	28.9	28.8	29.5	30.2	22.0	22.7	22.6	23.3	24.0
8H 4H	25.2	26.0	25.8	26.6	27.3	22.1	22.9	22.7	23.5	24.2
6H	26.5	27.2	27.1	27.8	28.5	22.2	22.9	22.9	23.6	24.3
8H	27.3	28.0	28.0	28.6	29.4	22.2	22.9	22.9	23.5	24.2
12H	28.5	29.1	29.2	29.7	30.5	22.2	22.8	22.9	23.4	24.2
12H 4H	25.1	25.9	25.8	26.5	27.2	22.1	22.9	22.8	23.5	24.2
6H	26.4	27.1	27.1	27.7	28.5	22.3	22.9	22.9	23.6	24.3
8H	27.3	27.9	28.0	28.5	29.3	22.3	22.8	23.0	23.5	24.3
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.1 / - 0.1					+ 0.3 / - 0.3				
1.5H	+ 0.3 / - 0.3					+ 0.2 / - 0.4				
2.0H	+ 0.5 / - 0.6					+ 0.5 / - 0.5				

CIE Pub.117, 952.9 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = -0.2)
 Area: 0.011 m2

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:
 Test Date:2024-07-06

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
k = 0.60	49	37	29	48	36	29	46	36	29	22
0.80	58	46	38	57	45	37	55	44	37	29
1.00	66	54	45	65	53	45	62	54	44	36
1.25	73	61	53	71	60	52	68	58	51	42
1.50	79	67	58	76	65	57	72	63	56	46
2.00	86	75	67	83	73	66	78	70	63	53
2.50	90	80	73	87	78	71	82	74	68	57
3.00	94	85	78	91	83	76	85	78	73	61
4.00	99	91	85	95	88	82	89	83	78	65
5.00	102	95	89	98	92	87	91	86	82	69
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended				SHRNOM = 1.25			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators:
 Test Date: 2024-07-06

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

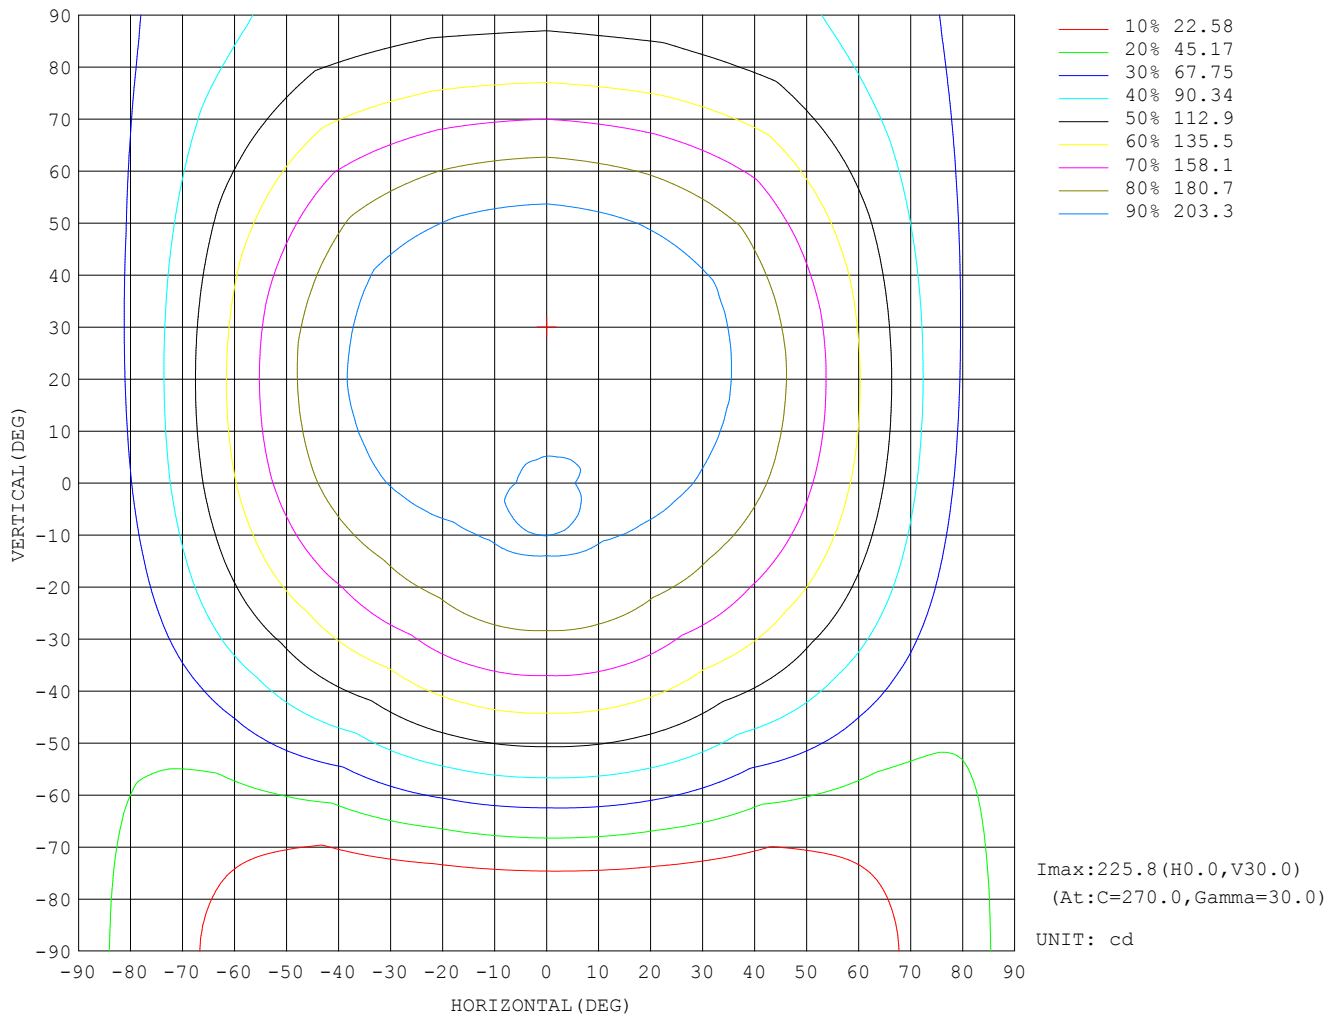

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators:
 Test Date: 2024-07-06

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:

AAI Figure

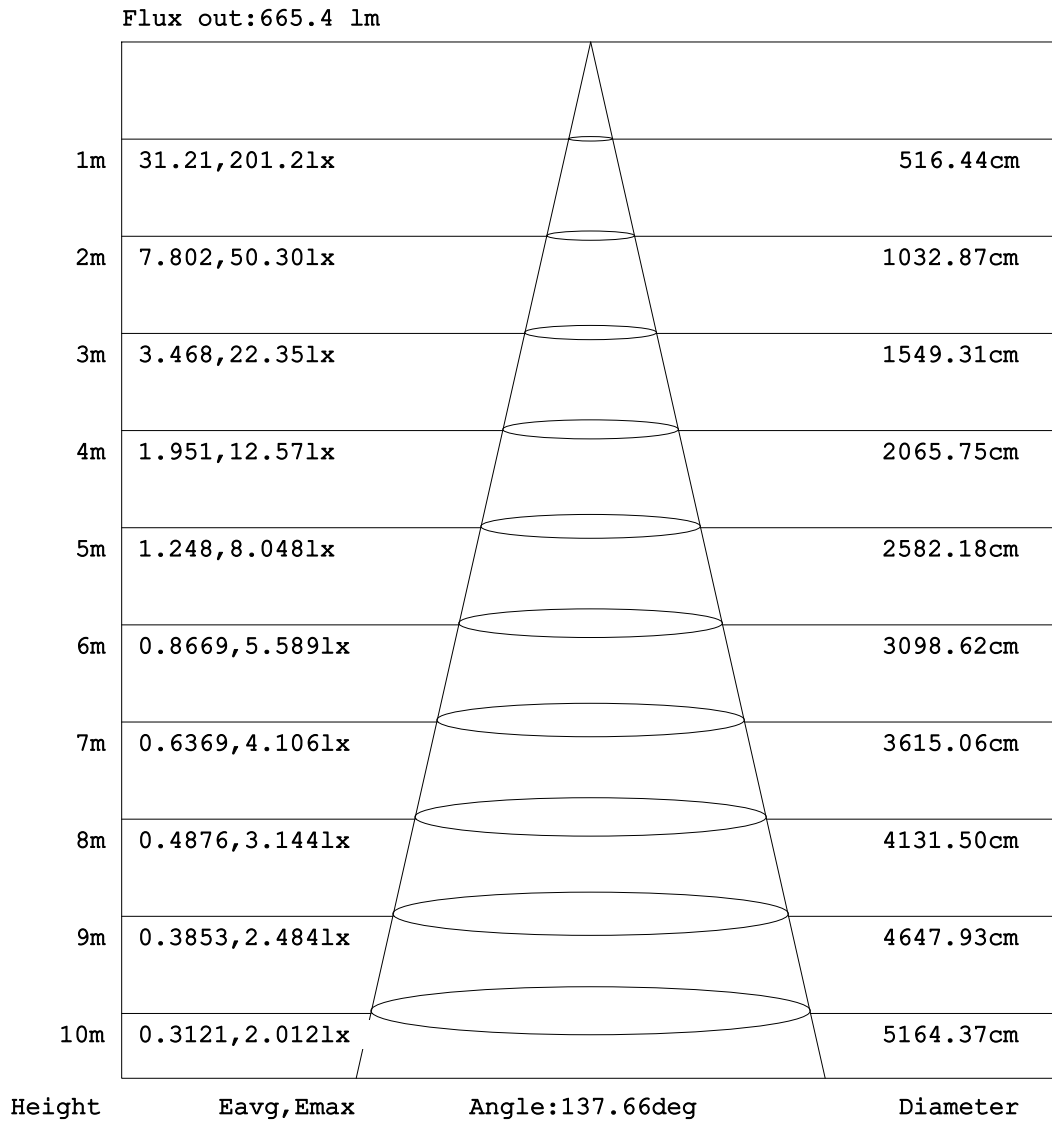


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:
 Test Date:2024-07-06

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

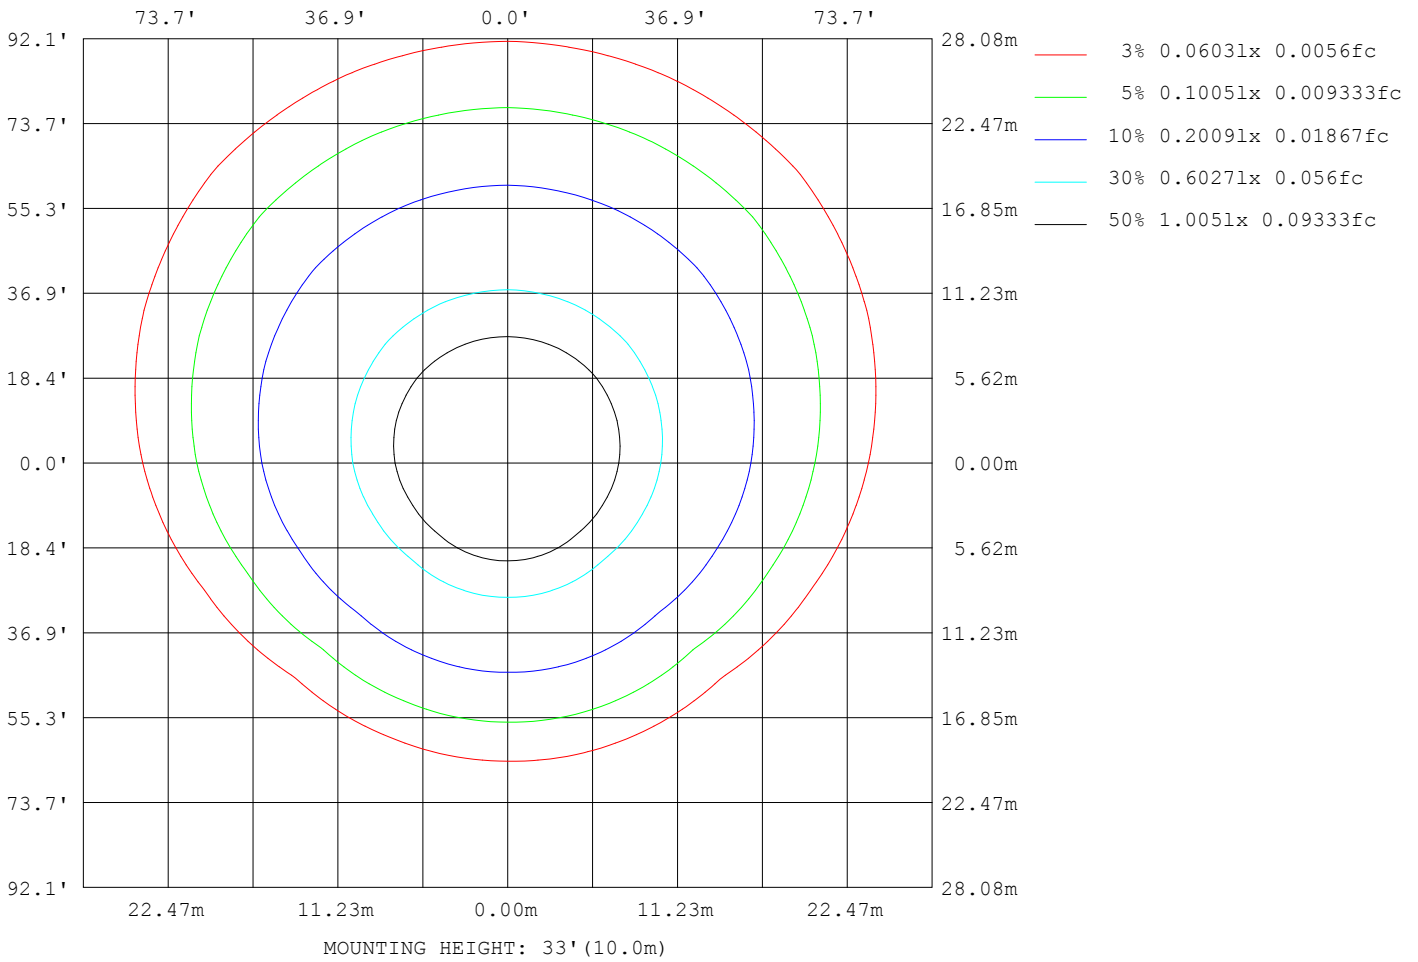

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators:
 Test Date: 2024-07-06

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:

LED Avg.L Report

Test:U:220.31V I:0.0637A P:13.615W PF:0.9707 Freq:50.00Hz Lamp Flux:952.92x1 lm		
NAME: GTG5081A-MCA125A-P03-12W-G4000K	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	24655
L_0~180 (75) av	27884
L_0~180 (85) av	58486
L_90~270 (65) av	24899
L_90~270 (75) av	28664
L_90~270 (85) av	61941
L_45 (65) av	24295
L_45 (75) av	27299
L_45 (85) av	57164

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: 10.0deg/s
Temperature:25.3°C
Operators:
Test Date:2024-07-06

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
Humidity:65.0%
Test Distance:9.000m [K=1.0000]
Remarks:

Planar Illuminance Curve

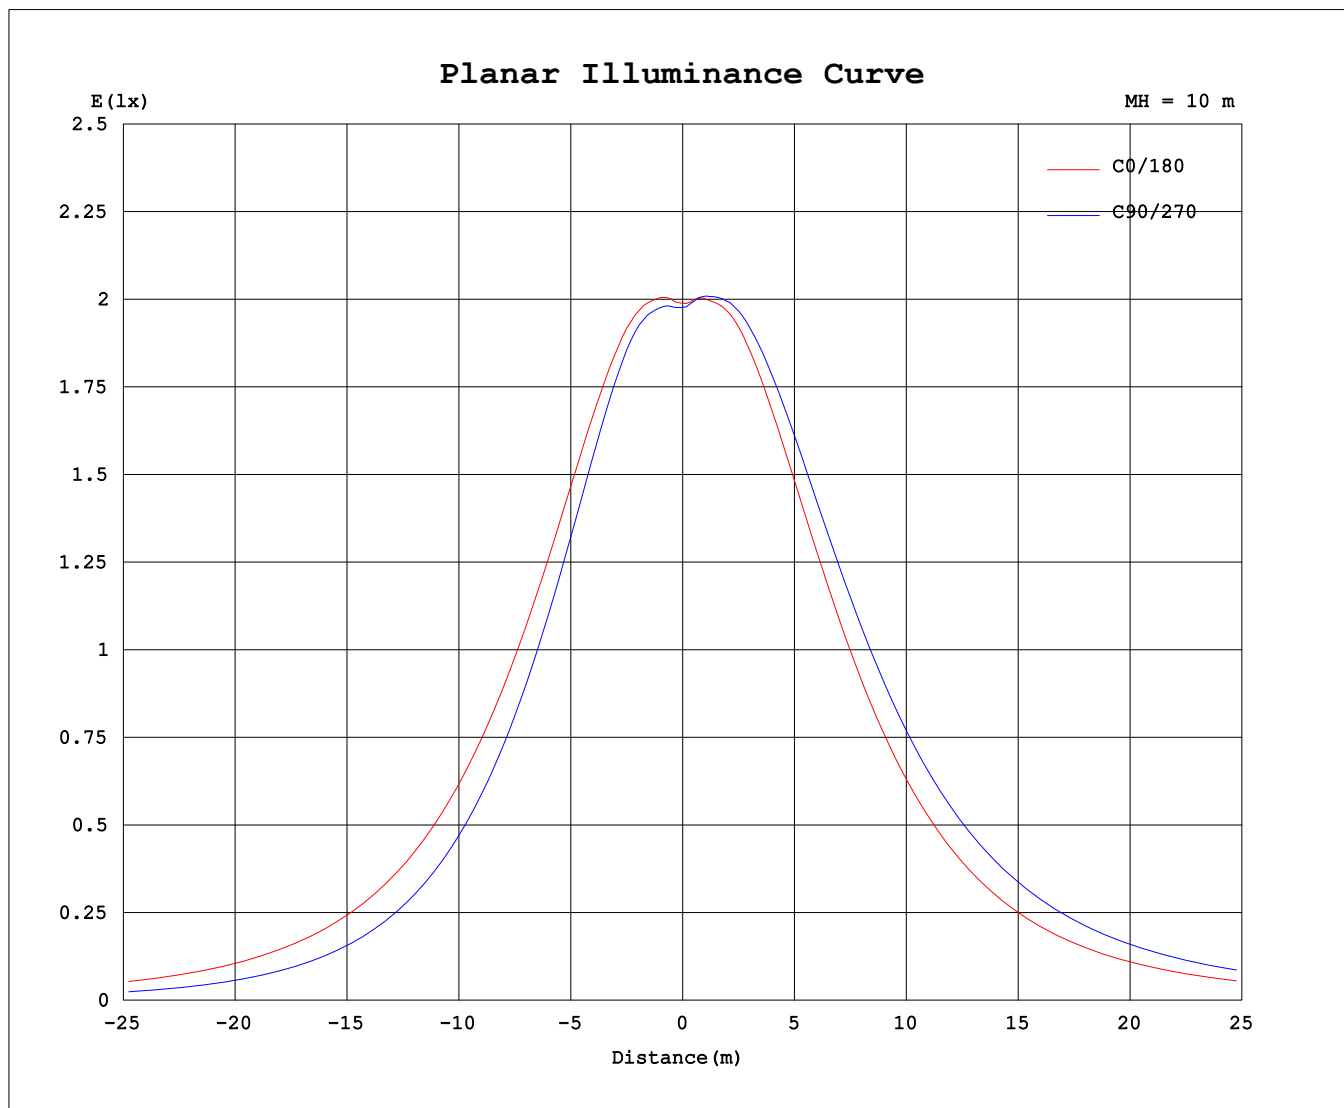

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature: 25.3°C
 Operators:
 Test Date: 2024-07-06

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity: 65.0%
 Test Distance: 9.000m [K=1.0000]
 Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C (DEG) \ γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	199	198	198	198	198	197	197	197	199	198	198	198	198	197	197	197			
5	203	202	201	200	200	200	200	200	203	203	203	203	203	203	202	201			
10	207	205	204	203	203	203	204	204	207	208	209	210	210	209	208	206			
15	210	206	204	203	202	203	204	205	211	214	215	217	217	216	214	211			
20	209	203	199	197	197	198	198	203	211	216	220	221	222	220	218	213			
25	206	197	190	189	188	189	191	197	208	217	222	224	225	223	220	213			
30	201	189	180	178	177	178	180	189	204	215	223	226	226	224	220	211			
35	194	179	167	165	164	165	168	179	198	212	222	225	225	223	219	208			
40	186	167	153	151	149	151	153	167	189	206	219	222	223	220	215	202			
45	175	153	137	135	133	134	137	154	178	198	213	217	218	215	209	194			
50	162	138	120	117	116	116	119	138	166	188	205	210	210	207	201	183			
55	147	121	101	98.6	96.7	97.5	100	121	151	176	194	199	200	197	190	171			
60	130	103	81.7	79.3	77.4	77.8	80.9	103	134	161	181	187	188	184	177	156			
65	112	83.9	61.8	58.8	57.8	56.6	61.0	84.2	117	145	166	172	174	170	163	140			
70	94.5	64.6	42.1	39.3	38.8	37.8	41.4	65.0	98.7	128	150	156	158	154	146	123			
75	77.4	46.2	24.1	22.0	21.4	20.9	23.4	46.5	81.4	111	134	140	142	138	130	106			
80	63.4	32.3	10.4	9.01	8.70	8.37	10.1	33.1	67.3	96.4	119	125	127	124	115	91.8			
85	54.9	24.7	3.50	2.59	2.44	2.45	3.63	25.9	57.3	86.5	108	115	116	113	104	82.4			
90	51.0	22.3	1.93	1.29	1.18	1.26	2.20	23.3	53.0	80.7	100	107	109	106	97.5	77.1			
95	50.3	21.9	1.93	1.41	1.30	1.38	2.18	22.7	51.7	75.7	92.0	101	104	100	91.0	73.0			
100	47.8	20.9	1.98	1.54	1.43	1.51	2.19	21.5	49.0	67.1	74.0	84.9	91.1	85.6	73.8	64.0			
105	44.2	19.3	2.04	1.69	1.61	1.64	2.19	19.6	44.9	58.0	54.2	67.0	74.1	68.1	53.9	54.6			
110	39.8	17.3	2.12	1.85	1.81	1.80	2.20	17.5	40.2	49.2	37.2	49.8	32.6	51.1	36.7	45.3			
115	35.0	15.1	2.19	1.94	1.93	1.89	2.21	15.2	35.2	42.2	22.7	34.3	6.24	35.5	21.7	37.6			
120	29.7	12.9	2.24	2.02	2.02	1.96	2.22	13.0	30.2	37.1	13.3	21.3	3.30	22.5	11.7	32.8			
125	24.9	10.7	2.27	2.08	2.09	2.01	2.22	10.8	25.2	31.4	7.64	11.4	3.17	10.0	5.76	27.7			
130	20.1	8.61	2.28	2.12	2.14	2.04	2.21	8.64	20.3	26.0	6.15	4.57	1.35	4.54	4.16	23.1			
135	15.5	6.71	2.26	2.15	2.17	2.07	2.19	6.68	15.7	21.8	6.83	1.77	1.22	1.79	5.13	19.6			
140	11.3	5.00	2.23	2.17	2.20	2.09	2.16	4.93	11.3	16.8	7.36	1.54	1.29	1.46	6.09	16.2			
145	7.49	3.57	2.20	2.18	2.22	2.11	2.10	3.48	7.47	11.2	6.60	1.77	1.41	1.65	5.89	11.5			
150	4.47	2.59	2.17	2.18	2.22	2.12	2.07	2.49	4.35	6.24	4.77	1.85	1.50	1.77	4.56	6.65			
155	2.49	2.17	2.14	2.17	2.18	2.14	2.06	2.09	2.40	2.80	2.52	1.74	1.59	1.77	2.79	3.09			
160	2.01	2.05	2.12	2.16	2.18	2.12	2.06	1.98	1.94	1.96	1.87	1.70	1.68	1.75	2.01	2.09			
165	1.95	2.04	2.10	2.13	2.10	2.11	2.06	2.00	1.91	1.82	1.79	1.77	1.77	1.79	1.83	1.89			
170	2.02	2.05	2.08	2.07	2.08	2.09	2.06	2.02	1.99	1.90	1.87	1.86	1.87	1.88	1.90	1.95			
175	2.07	2.05	2.05	2.05	2.06	2.06	2.06	2.04	2.06	1.98	1.95	1.94	1.95	1.96	1.98	2.01			
180	2.09	2.03	2.02	2.02	2.01	2.02	2.03	2.05	2.10	2.03	2.02	2.01	2.02	2.02	2.03	2.04			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: 10.0deg/s
 Temperature:25.3°C
 Operators:
 Test Date:2024-07-06

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-3000H_V1 SYSTEM V2.00.463
 Humidity:65.0%
 Test Distance:9.000m [K=1.0000]
 Remarks: