

### **Sinusoidal Emergency Micro Inverter**

- Emergency Micro Inverter with sine wave output
- Universal AC Input Voltage: 100-277VAC
- Auto Select Output Voltage: 120/220/260VAC
- Driver Type: Limit Max Power

### Output Power: 50W Max, 10-50W Programmable

- Emergency Battery Disengage
- Suitable for use in dry and damp locations
- IP20

#### **General Specifications**

Input Voltage / Frequency	100-277VAC , 50/60Hz
Input Current	0.2A Max
Input Power	20W Max
AC Load Input Power	320W Max. when using 0-10V dimming
	50W Max. when 0-10V dimming is not used
Maintain power	0.68W
Driver Type	Limit Max Power
Output Power	50W Max.(100VA Max.)
Output Voltage Range	120/220/260VAC,60Hz.
Load Power Factor Range	50W Load [PF[>0.55
Number of Output Channels	1 Channel
RFI/EMI	FCC Part 15A Non-Consumer
Output Type	Isolated
Battery Type	LiFePO4
Battery Capacity Available	7200mAh
Battery Recharge Time	12Hours
Battery Discharge Time	90 Minutes Min.
Test Switch Wire Length	23" (584.2mm)
Test Switch Remote Mounting Distance	65.6' (20m) Max.
Optional Wet Location Test Switch	FHS-TSTWL-BC
Accessories	Wall Plate (FHSWLPWH)
Input Surge Protection	2.5KV Ring wave
Protections	Under Voltage Protection
	Overload Protection
	Short Circuit Protection
Rated Ambient(ta)	0°C To 50°C (32°F To 122°F)
Тс	60°C(140°F)
Sound Rating	Α
Service Life	50,000 hours
Warranty	5 years
Approvals/Class	UL924, CSA C22.2 NO.141-10/cUL
	CEC Title 20
	IP20














#### **Mechanical Diagram**

Overall Di	mensions
Length	17.37" [441.2mm]
Width	3.04" [77.3mm]
Height	2.29" [58.1mm]

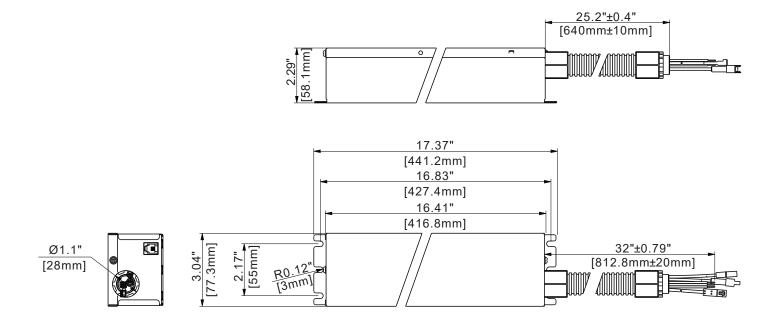






(вс

# CIP-FHUPS1-UN V-50L-SD

#### Accessories


Test switch wire

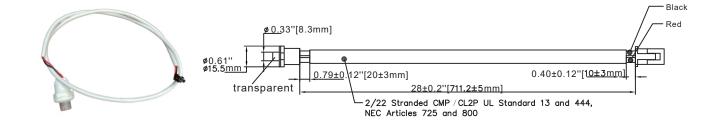

#### **Optional Accessories**


#### Bi-Color Wet Location Test Switch: FHS-TSTWL-BC



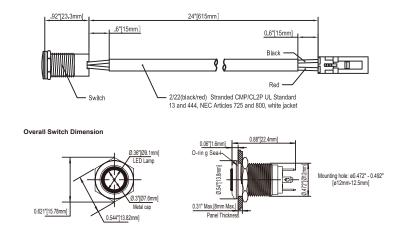


IP20 Rohs

#### Test Switch Extension: FHS-EXT-48-TST

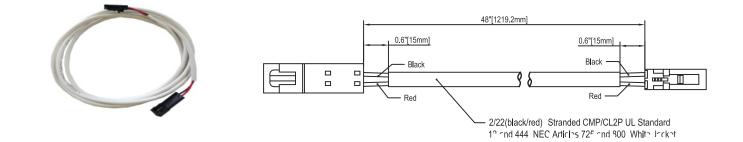






Wall Plate: FHSWLPWH




Wall plate and screw color: white with black lettering

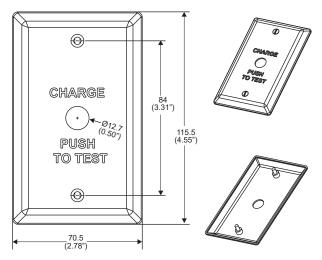

1."Charge push to Test"plate


2. (2) 6-32 x 1/2"LG mounting screws






Wiring Diagram 1

For Luminaire(s) with an output power less than 50W (100VA) and Non 0-10 dimming function.

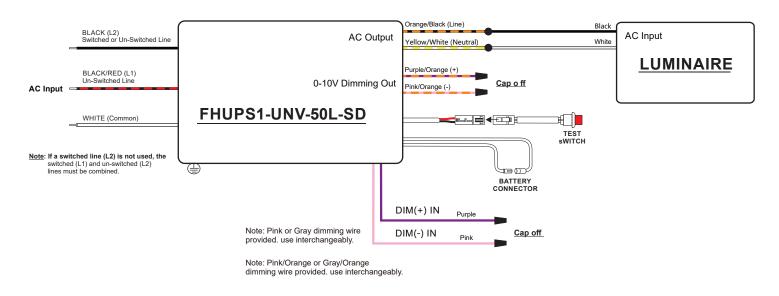

#### Wiring Diagram 2

For Luminaire(s) with an output power less than 320W (400VA) and have 0-10 dimming function.

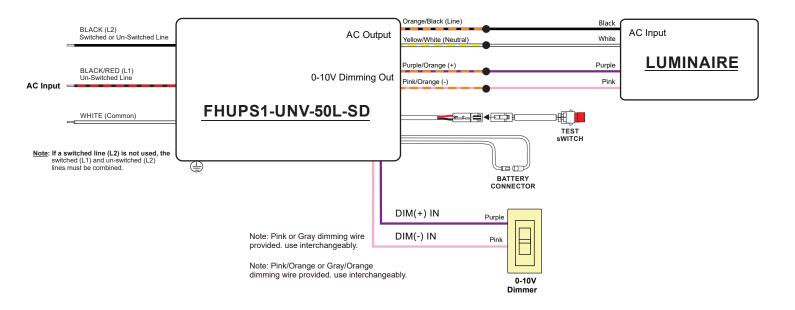






Wiring Diagram 3

For Luminaire(s) with an output power less than 320W and 0-10 dimming function but 0-10V dimming is not used during normal operation.

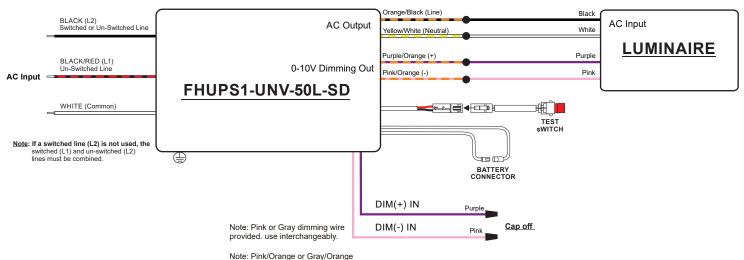


dimming wire provided. use interchangeably.





Wiring Diagram 4


### Wiring one single luminaire without 0-10V dimming



One 50W luminaire powered at 100% during emergency

#### Wiring Diagram 5


### Wiring multiple luminaires without 0-10V dimming



• Five 10W luminaires powed at 10W each during emergency

#### Wiring Diagram 6

### Wiring multiple luminaires with 0-10V dimming

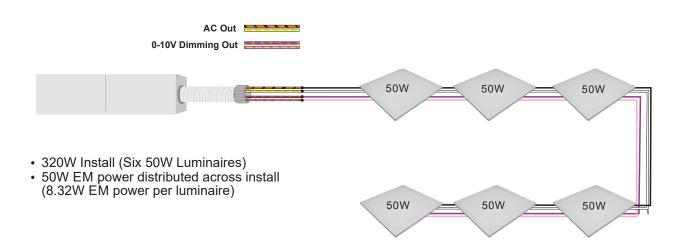







# 

#### **TEST SWITCH INDICATOR STATUS:**

LED Indicator Status	EM Driver Status/Mode
Solid Green	System OK/AC OK(Self-diagnostic Enabled or Disabled)
<ul> <li>Slow Flashing Red, 4s on/1s off</li> </ul>	Battery not detected, check battery switch or connection.
Flashing Red, 1s on/1s off	Battery short circuit.
Flashing Green, 2s on/2s off	Self-diagnostic test underway.
<ul> <li>Flashing Red, 0.5s on/2s off</li> </ul>	Over power fault.
Flashing Red, 0.5s on/3s off	In self-diagnostic mode. Battery voltage/power is abnormal.
• Flashing Green, 2.5s on/0.5s off	Self-diagnostic enabled.
• Flashing Green, 0.5s on/2.5s off	Self-diagnostic disabled.

\*Notes: OTP= OverTemperature Protection; ensures max temperature ratings are not exceeded. .

#### **TEST SWITCH OPERATIONS:**

1.EM Test: Press and hold the test button (>1s) to enter EM mode in normal AC powered.

2.Manual Self-Diagnostic:Battery voltage greater than 20.4V ,or change for 12 hours. Quickly press the test button three times within three seconds to force the controller enter a Self-Diagnostic cycle. To quit the self-diagnostic cycle after engaged press and hold the test button for three seconds.

3.Enable/Disable Auto Self-Diagnostic: Press and hold the test button for two seconds, then release and quickly press the test button two times, then release and press and hold the test button for two more seconds. When properly executed the indicator on the test button will display the appropriate Enable/Disable status.Aflashing of 2.5s ON/0.5s OFF means"Enabled", while a flashing of 0.5s ON/2.5s OFF means"Disabled". Once Enable/Disable is set the status color on the test button will remain the same throughout normal operation (refer to Indicator StatusTable).

Check the current status: Press the button twice within 2 seconds. If the LED Indicator Status is 2.5s on/0.5s off, the current state is enabled. If the LED Indicator Status is 0.5s on/2.5s off, the current status is self-diagnostic disabled.

Self-diagnostic settings: Press the test button once quickly. Then release and then press and hold the test button for 2s and then release

#### **Emergency Battery Disconnect:**

Press and hold the test switch for 5 seconds during EM output condition to turn off EM output. This is useful for production environment to turn off the EM output once a luminaire has completed functionality testing.








#### **Programming:**

The FHUPS1-UNV-50L-SD is programmed through the program wire on the emergency driver with the TPSB-100 programmer. Unless otherwise programmed the output will self-program to the maximum rating of the battery. Customer must use the programming harness and programming block that comes with the TPSB-100.

#### **Programming Wire Diagram**

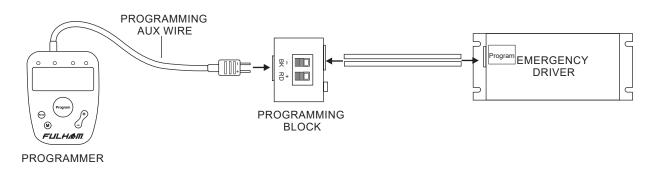

#### **Programming Features**

- Output EM Power
- \* Enable / Disable Self-Diagnosic



\* For more detailed programming instructions please see our Programming Instructions and Design Guide found on our website.




IP20 CRASS

Access on any browser

Phone, tablet, or pc

Ø Dashboard	Q 4765	4765 💉 4765 😭 0 🕕 0				œ	Hexmodal Hospital: E-Lights			🔎 Christopher Hariz 🛔			
Device Type: E-Lights * PAGES o;	View Details O View	Compliant Details O V	View Details	0	View Details •	Dashboard Device Type: E+Lights ~	In Compliance. Completed this Month's Testing.				Run Test		
Manage Facility o( Devices	Map Fitter by Building * Hermodal Total Devices 61				<ul> <li>Reports</li> <li>750 Manhattan Ave.</li> </ul>	PAGES	Device ID: FH001 Edit Deactivate/Replace				Compliance Status		
ili Users		Device kons			Broeklyn, NY 11101 E-Lights August 08, 2024 750 Manhattan Ave, Broeklyn, NY 11101	Manage Facility	Building	Orlando Convention Center	Facility Contact Remote Head	Fulham Demo None No	Passed Last Test Passed Last 90 min. Discharge Test	3	
Alert Settings			11 22 34	33 	E-Lights July 08, 2024 50 Manhattan Ave, Brooklyn, NY 11101	≞ Users	Location Equipment Type Model #	NFPA Booth Demo	Last Seen Last Test on:	June 19, 2024, 1:58 p.m. June 19, 2024, 12:25 p.m.	Test This Month 90 min. Discharge Test This Year	2 2	
Reports				1000	E-Lights June 08, 2024 50 Manhattan Ave, Brooklyn, NY 11101 E-Lights May 08, 2024	Alert Settings	Serial # Device Group	FH001 Default Device Group	Last 90 min. Test on: Connected Gateways:	June 13, 2024, 12:53 p.m. None	Communication	✓ High	
Gateways			1 h. h <sup>2</sup> _	50000	* 1 2 3 389 390 *	Reports	Eq. Status	In Service	Gateways.				

# For ceiling E-Light Luminaires 2X4 & 2X2 troffers

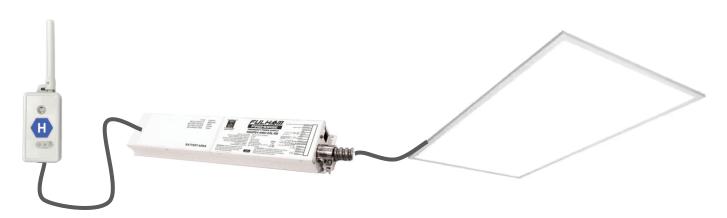


Hexmodal Smart Dongle and Microinverter converts any ceiling e-light into a mart, self-testing light




info@hexmodal.com | 201.754.8048 | 750 Manhattan Ave New York, NY





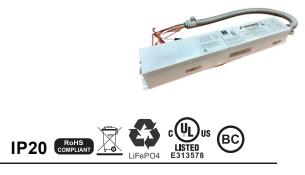

IT Needed. Simple. Independent. Secure

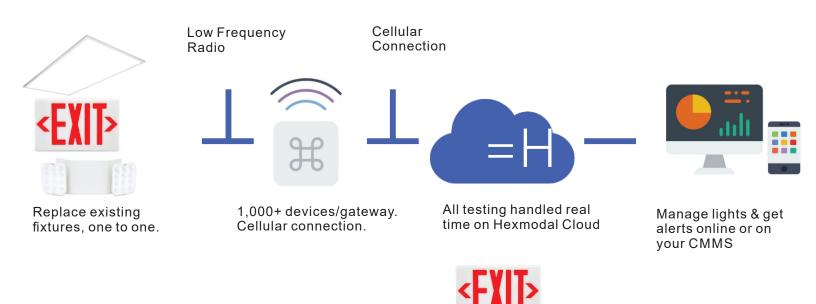



info@hexmodal.com | 201.754.8048 | 750 Manhattan Ave New York, NY







## GENERAL INSTALLATION GUIDELINES FOR LED EMERGENCY MICRO INVERTER

# **IMPORTANT SAFE PRACTICES**

When using electrical equipment and this lighting device basic safety precaution should be followed at all times including but not limited to the following:

# PLEASE READ CAREFULLYAND FOLLOW ALL INSTRUCTIONS FOR YOUR OWN SAFETY IMPORTANT: Do not connect battery until fixture is installed.

#### IMPORTANT: An un-switched AC power source of 100VAC to 277VAC is required.

This device is designed for use in fixtures listed for dry and damp locations.

**CAUTION:** Make sure all electrical connections conform to the National Electrical Code and all applicable local regulations.

CAUTION: Do not let power supply cords touch hot surfaces.

**CAUTION**: Do not mount near gas or electric heaters.

CAUTION: Do not use outdoors.

**CAUTION**: Battery is rechargeable LiFePO4 type and must be recycled or disposed of properly. Do not use this emergency driver with accessory equipment other than recommended by manufacturer; failure to follow this may cause an unsafe condition. Servicing should only be performed by qualified service personnel. Do not use this emergency driver for other than intended use.

**CAUTION:**Equipment should be mounted in locations and at heights where it will not readily be subjected to tampering by unauthorized personnel.

CAUTION: For use with a metal enclosed wiring system.

# IMPORTANT: The output EM power will be the maximum of connected battery unless programmed to a lesser value. EM output power will not exceed the battery rating.

**IMPORTANT:** Indicator (LED light) illuminated indicates battery in charge mode whenAC power is applied. It is recommended and required by applicable code to test emergency function to ensure proper operation of the system; push the test switch for sixty (60) seconds every 30 days to ensure the emergency driver is functioning as LED light source illuminated. Conduct a ninety minute (90) discharge test one time (1) per year; LED light source should be illuminated for a minimum of ninety minutes (90).

**ASSEMBLYand FIELD INSTALLATION WIRING: WARNING:** AC power must be off before proceeding with assembly or installation of emergency driver.

**TESTING SYSTEM:** The emergency battery requires a charge minimum of one (1) hour before testing the circuit. A full charge requires twelve (12) hours (Refer to battery chart).

**IMPORTANT: In order to maintain proper operation and warranty coverage, the battery must be recharged once per** year prior to installation.

### SAVE THESE INSTRUCTIONS





ВС

# CIP-FHUPS1-UN V-50L-SD

#### Guidelines

#### Grounding

• Inverter must be grounded by means of the inverter case.

#### **Overload Protection**

 If the maximum output power exceeded, the inverter will be switched off automatically; after the elimination of the overload, the normal operation will be restored automatically.

IP20 COMPLIA

• If it is overloaded during emergency, it needs to be AC powered again after triggering the protection.

#### Load

FHUPS1-UNV-50L-SD inverter can operate a maximum 50W, PF>0.55 (100VA) load with no 0-10V dimming function; or it can
also operate a maximum 320W (400VA) load with 0-10V dimming function, and the dimming function is required to be able to
dim the load below 50W(100VA).

#### Short-circuit protection

- In case of a short circuit, the inverter switches to protection mode. After the removal of the short-circuit the inverter will recover automatically.
- In case of short circuit during emergency, power on again after the short circuit fault is removed.

#### **Under-Voltage protection**

• When the line voltage is reduced to the critical voltage, the inverter will instantly provide emergency power to the load.

#### Hot Swapping

This inverter does not support hot swapping of the LEDs

#### **Remote Mounting**

• Up to 164ft (50m) with 18AWG. Contact Fulham for higher remote distance.

#### **Battery Maintenance**

In order to maintain proper operation and warranty coverage, the battery must be recharged once per year prior to installation.

#### Warranty

• Reference CIP's limited Warranty.







**Product Image:** 

#### CIP-FHUPS1-UNV-50L-SD



